


# AirCheckup™ Instructions

## Air Contamination Sampler for Data Centers


Use of this product subject to TERMS at [www.technologycare.com](http://www.technologycare.com)  
© Technology Care LLC - All rights reserved - Intl. Patents Pending

### Test Start

**1**  
Write the "Start Date" on the sampler.



**2**




Stick the sampler to a vertical surface where it will not be disturbed or touched such as a wall, pillar or rack. Can also be mounted inside racks, cabinets and air ducts.





**Recommended Test Period: 30 - 365 Days**

**3**  
Slowly rotate sampler to remove. Do not pull since this could damage painted surfaces. Rub to remove remaining adhesive.



**4**

Write the "End Date" on the sampler and fill in the information on the back of the return mailer



**5**  
Seal sampler in sampler bag and send to our laboratory with the postage-paid mailer. The laboratory report will be sent by email.


# CorrAlert™ Instructions

## Corrosion Indicator Card


Use of this product subject to TERMS at [www.technologycare.com](http://www.technologycare.com)  
© Technology Care LLC - All rights reserved - Intl. Patents Pending

### Test Start

**1**  
Write the "Start Date" on the sampler.



**2**




Stick the sampler to a vertical surface where it will not be disturbed or touched such as a wall, pillar or rack. Can also be mounted inside racks, cabinets and air ducts.



**Recommended Test Period: 30 - 365 Days**

**3**

Slowly rotate sampler to remove. Do not pull since this could damage painted surfaces. Rub to remove remaining adhesive.



**4**

Write the "End Date" on the sampler and fill in the information on the back of the return mailer



**5**  
Seal sampler in sampler bag and send to our laboratory with the postage-paid mailer. The laboratory report will be sent by email.


# CorrAlert™ Instructions

## Corrosion Indicator Card


Use of this product subject to TERMS at [www.technologycare.com](http://www.technologycare.com)  
© Technology Care LLC - All rights reserved - Intl. Patents Pending

### Test Start

**1**  
Write the "Start Date" on the sampler.



**2**




Stick the sampler to a vertical surface where it will not be disturbed or touched such as a wall, pillar or rack. Can also be mounted inside racks, cabinets and air ducts.



**Recommended Test Period: 30 - 365 Days**


**3**

Slowly rotate sampler to remove. Do not pull since this could damage painted surfaces. Rub to remove remaining adhesive.



**4**

Write the "End Date" on the sampler and fill in the information on the back of the return mailer

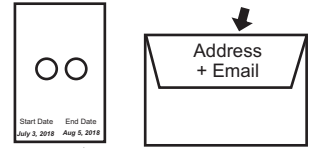

**5**  
Seal sampler in sampler bag and send to our laboratory with the postage-paid mailer. The laboratory report will be sent by email.


# CorrAlert™ Instructions

## Corrosion Indicator Card


Use of this product subject to TERMS at [www.technologycare.com](http://www.technologycare.com)  
© Technology Care LLC - All rights reserved - Intl. Patents Pending

### Test Start

**1**  
Write the "Start Date" on the sampler.



**2**




Stick the sampler to a vertical surface where it will not be disturbed or touched such as a wall, pillar or rack. Can also be mounted inside racks, cabinets and air ducts.



**Recommended Test Period: 30 - 365 Days**


**3**

Slowly rotate sampler to remove. Do not pull since this could damage painted surfaces. Rub to remove remaining adhesive.



**4**

Write the "End Date" on the sampler and fill in the information on the back of the return mailer



**5**  
Seal sampler in sampler bag and send to our laboratory with the postage-paid mailer. The laboratory report will be sent by email.


# CorrAlert™ Instructions

## Corrosion Indicator Card


Use of this product subject to TERMS at [www.technologycare.com](http://www.technologycare.com)  
© Technology Care LLC - All rights reserved - Intl. Patents Pending

### Test Start

**1**  
Write the "Start Date" on the sampler.



**2**




Stick the sampler to a vertical surface where it will not be disturbed or touched such as a wall, pillar or rack. Can also be mounted inside racks, cabinets and air ducts.



**Recommended Test Period: 30 - 365 Days**


**3**

Slowly rotate sampler to remove. Do not pull since this could damage painted surfaces. Rub to remove remaining adhesive.



**4**

Write the "End Date" on the sampler and fill in the information on the back of the return mailer

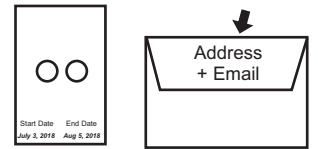


**5**  
Seal sampler in sampler bag and send to our laboratory with the postage-paid mailer. The laboratory report will be sent by email.


# AirGerm™

## Anleitung zum Lufthygienetest

Inhalt des Kits: Luftprobenehmer, wiederverschließbarer Probenahmebeutel, Anleitung und portofreier Rücksendeumschlag für die Laborverarbeitung.




- 1 Öffnen Sie den Beutel vor der Entnahme des Probenehmers so, dass die klebrige Kollektorfläche vom Inneren des Beutels getrennt wird.



- 2 Legen Sie den Probenehmer auf eine ebene Fläche, z. B. auf einen Tisch, ein Regal oder auf die Oberseite eines Gestells, wo er nicht gestört wird. Notieren Sie die Startzeit auf dem Rücksendeumschlag.



**Testdauer: 1 - 365 Tage**



- 3 Verschiessen Sie den Probenehmer wieder im Probenahmebeutel. Füllen Sie die Informationen auf der Rückseite des Rücksendungsumschlags aus und senden Sie ihn zur Bearbeitung an das Labor. Wenn Ihr Probenehmer in unserem Labor eintrifft, informieren wir Sie per E-Mail. Sie können dann den/die Laborbericht(e) unter [www.airgerm.com](http://www.airgerm.com) bestellen.

Use of this product subject to TERMS at [airgerm.com](http://airgerm.com)  
Manufactured by:

Technology Care LLC  
Birmensdorferstrasse 467  
8055 Zurich, Switzerland  
Tel. 044 450 85 60, Email: [contact@technologycare.com](mailto:contact@technologycare.com)  
© Technology Care LLC - All rights reserved - Intl. Patents Pending